



DOUGLAS ITALIA S.P.A.

THERMODYNAMIC STEAM TRAPS DC 50/A F 304

THERMODYNAMIC

This type of trap uses steam dynamic energy to close the discharge orifice. A disc closes both the inlet and outlet orifice. Condensate can lift the disc and be discharge, but when steam is formed its dynamic energy will create a low pressure area (Bernulli Law) under the disc which draws it towards the seat.




MAIN FEATURES

Reduced dimension and weight simple and reliable. **Special air venting disc.** It withstands waterhammer. Condensate discharge is intermittent. Some loss of live steam.

APPLICATIONS

- Ironing machines
- Steam mains
- Tracing lines
- Turbines
- Marine applications
- Presses

DISCHARGE CAPACITY

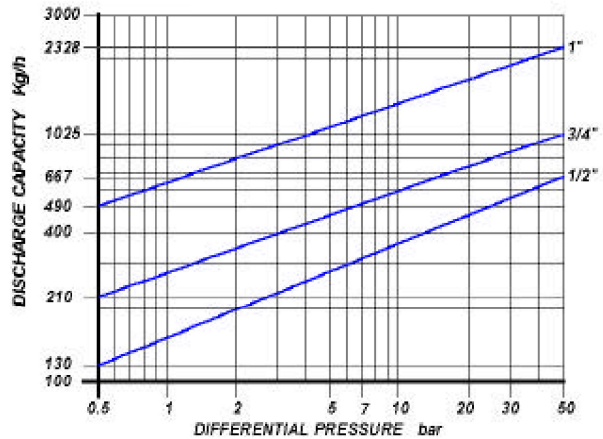

Cold water capacities are 2 to 4 times greater than the above .
Safety factor = 1.2 – 1.5

SIZES

1/2" – 3/4" – 1"


CONNECTIONS

Screwed	ANSI B1.20.1 (NPT) / BS21 (BSP)
Socket Welding	ANSI B16.11
Flanged	ANSI 150#/300#/600#/UNI/DIN

LIMITING CONDITIONS (according to ISO 6552)

Steam Trap rating	ANSI 600
PMA: Max allowable pressure	100 bar
TMA: max allowable temperature	500°C
PMO: max working pressure	50 bar
TMO: max working temperature	425°C
Minimum Working Pressure	0.25 bar
PMOB: max working back pressure	80%


THERMODYNAMIC STEAM TRAPS DC 50/A F 304

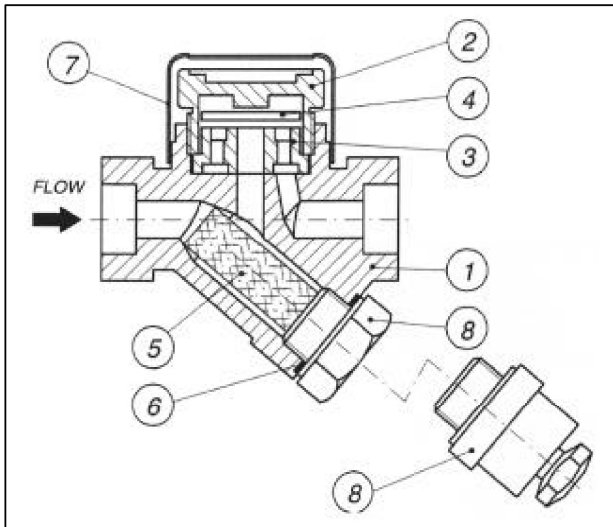

POS.	DESCRIPTION	MATERIALS	SPARES
1	Body	ASTM A182 F304	
2	Cover	AISI 303	
3	Seat	AISI 431	X
4	Disc	AISI 431	X
5	Screen	AISI 304	X
6	Gasket	316/GRAPHITE	X
7	Insulating cap*	AISI 304	
8	Strainer cap	ASTM A182 F304	
8	Blow off valve*	AISI 416	
9	Flange	ASTM A182 F304	

* optional

Size (inches)	S	A	B	C	Weight (Kg)	Flanged							
						UNI-DIN PN16-25-40		150#		300#		600#	
						SF	Kg	SF	Kg	SF	Kg	SF	Kg
½"	85	108	55	48	0.8	151	2.4	145	2.2	165	2.4	175	2.5
¾"	100	120	60	54	1.3	170	3.6	170	3	190	4.1	200	4.5
1"	108	130	70	62	3.4	178	5.2	188	4.6	198	5.8	218	6.2

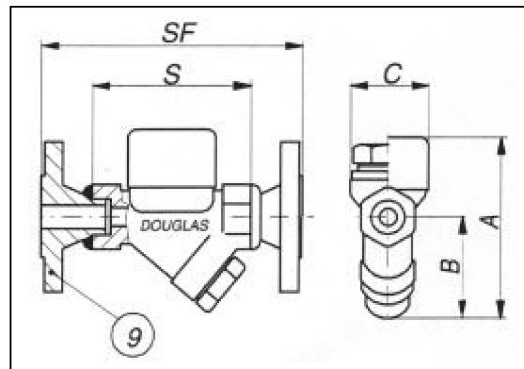

INSTALLATION

The steam trap can be installed in any position, however it should be preferably fitted on horizontal pipelines.

HOW TO SERVICE

By installing a new seat-disc assembly you can bring the steam trap to the "as new from factory" condition. This operation is carried out in a few minutes without removing steam trap from the pipeline. Remove insulating cap if fitted and unscrew cover(2) and remove disc(4), seat(3) and clean the inside of the trap. When re-assembling the disc is normally placed in position with the grooved side in contact with the seat. Screw on cover(2) using a high temperature grease. To service the strainer cap(8), withdraw screen(5) and clean or replace it. When servicing the trap always fit the new gasket.

How to order: i.e. DC 50 /A F304 ¾" NPT

DOUGLAS ITALIA S.p.A Località Pradaglie – 29013 CARPANETO PIACENTINO (PC)

OFFICIAL WEB SITE: www.douglas-italia.com